


**ART.1595 12**

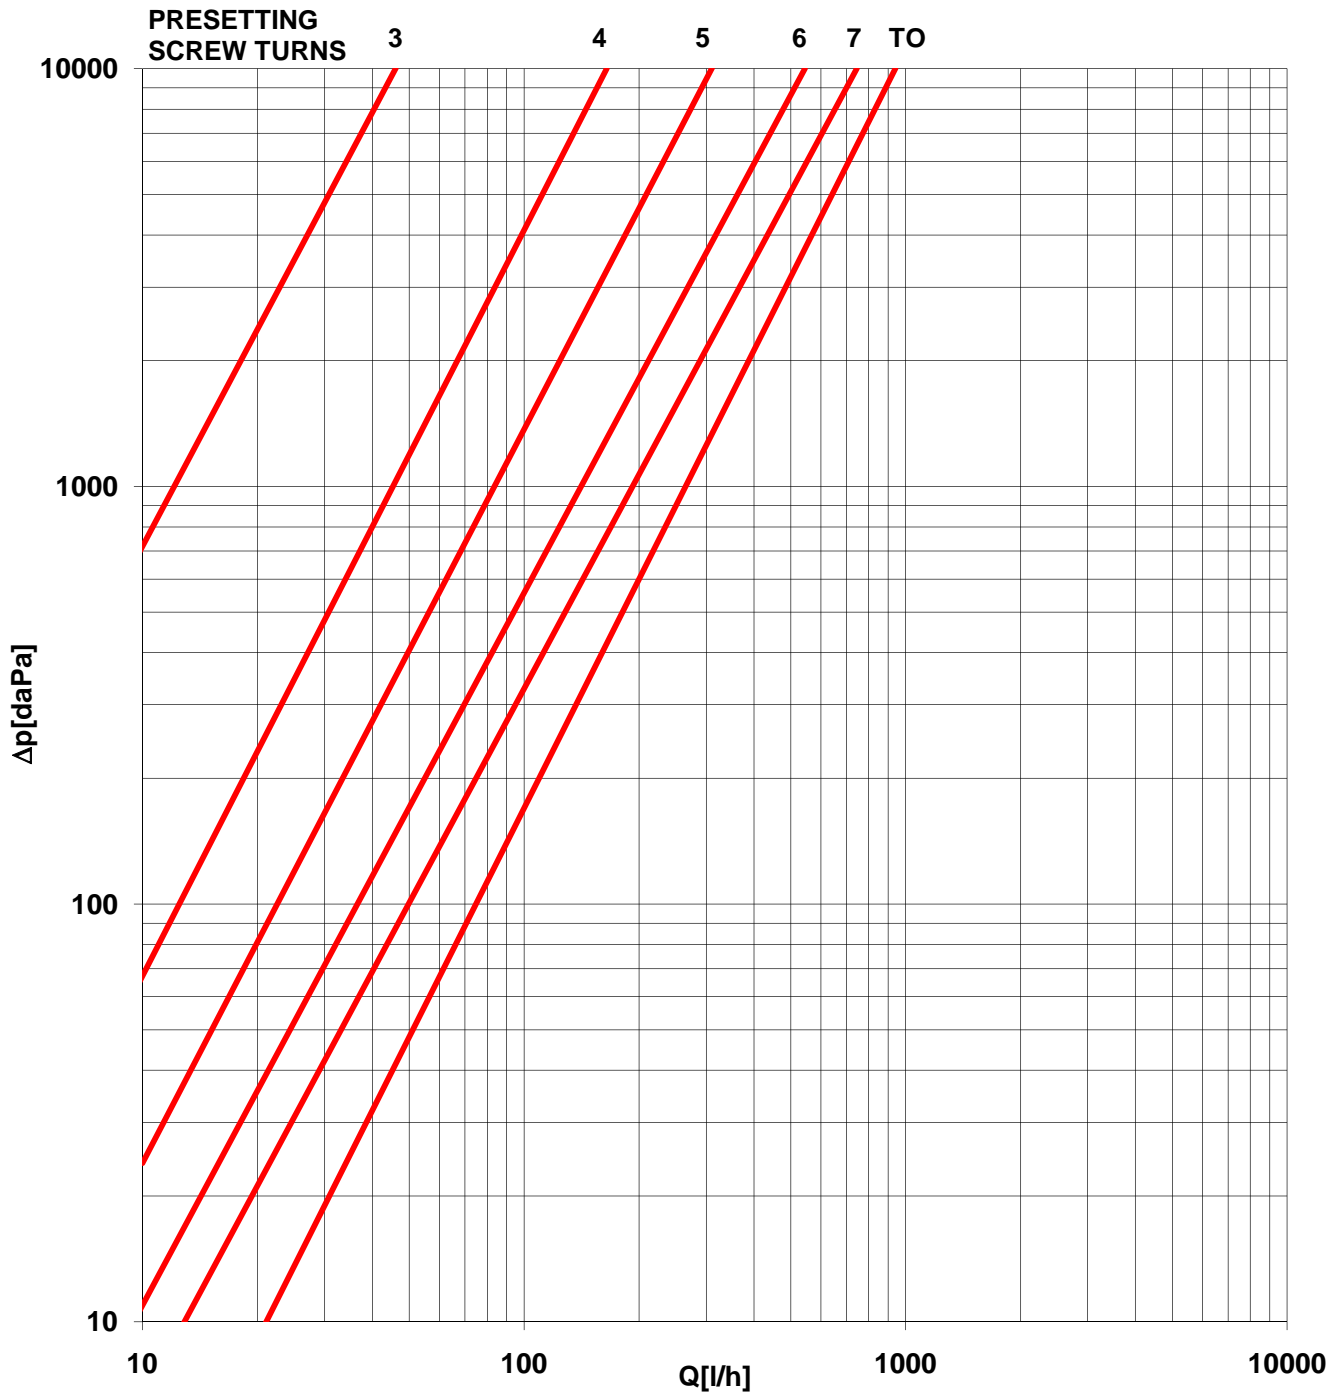

PRESETTING SCREW TURNS	3	4	5	6	7	TO
Kv [m³/h]	0,04	0,16	0,3	0,54	0,74	0,94
Q% Radiator	2,3	3,2	3,4	25,5	40,2	64,6
Q% By.pass	97,7	96,8	96,6	84,5	59,8	35,4