


ART.1415 12

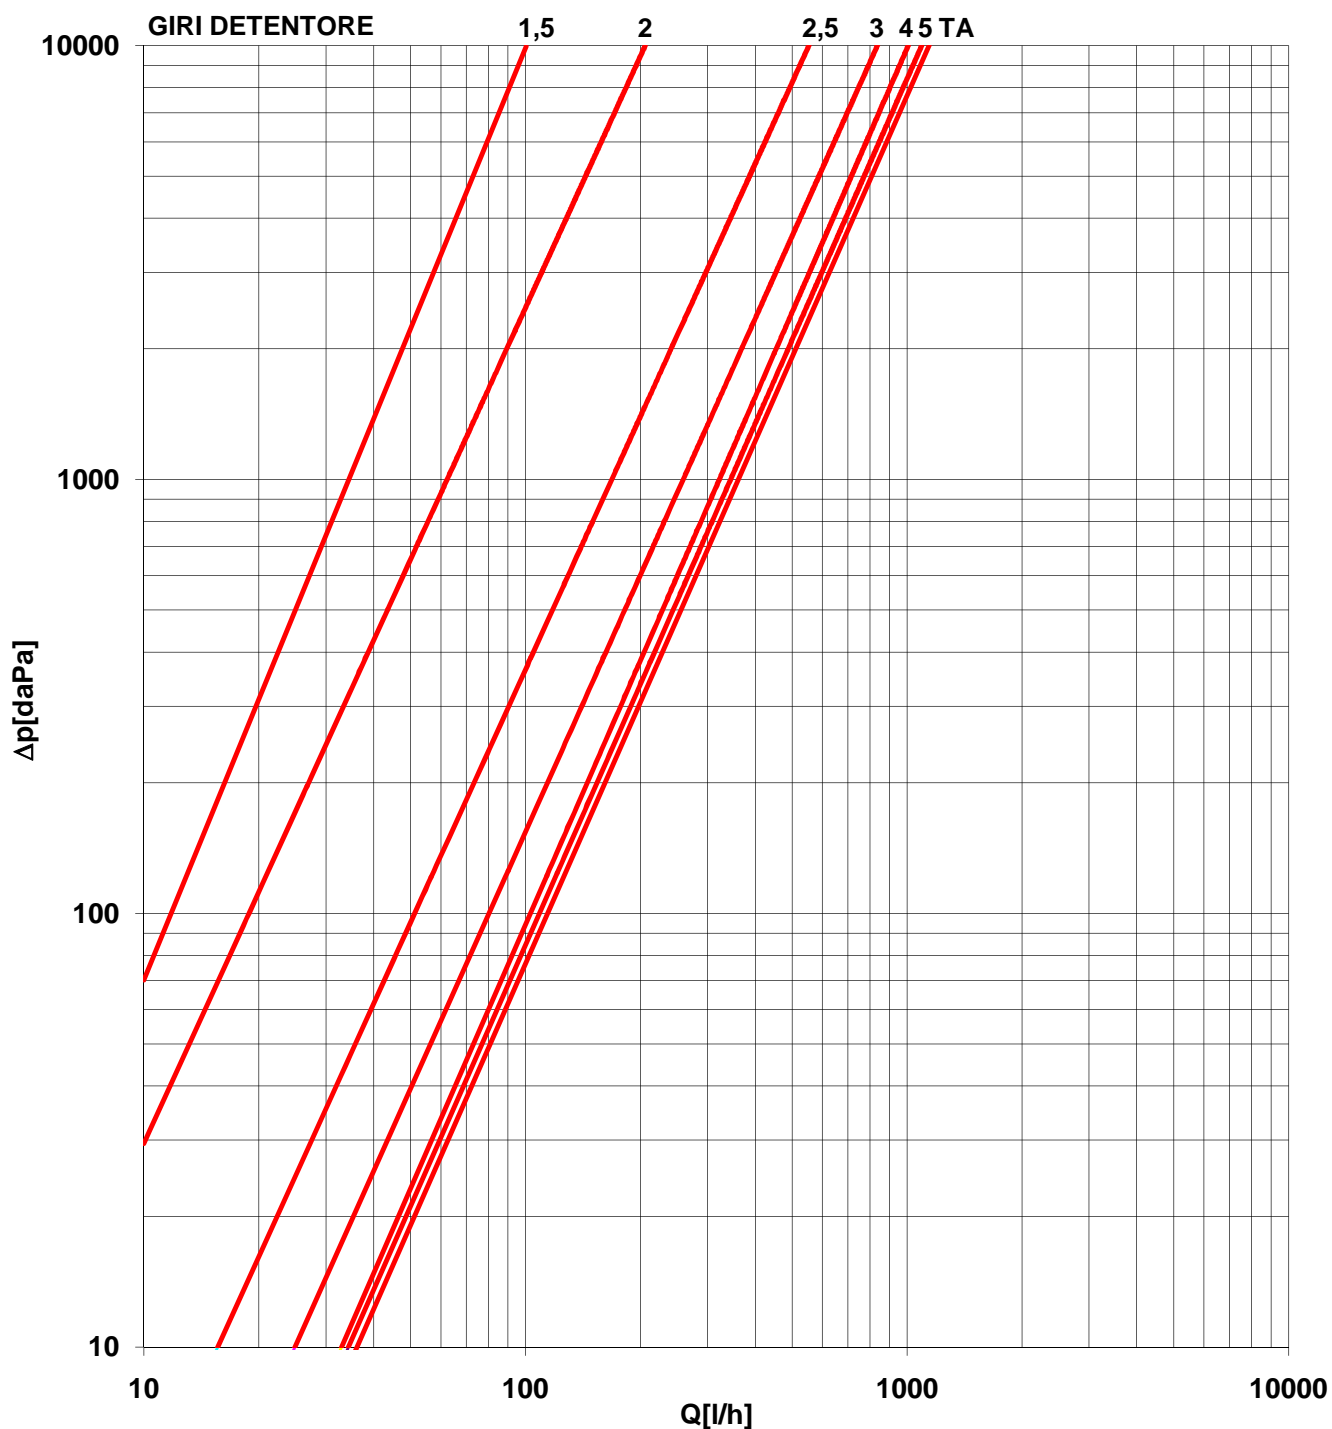

GIRI	1,5	2	2,5	3	4	5	TA
Kv [m³/h]	0,1	0,2	0,55	0,83	1	1,1	1,5